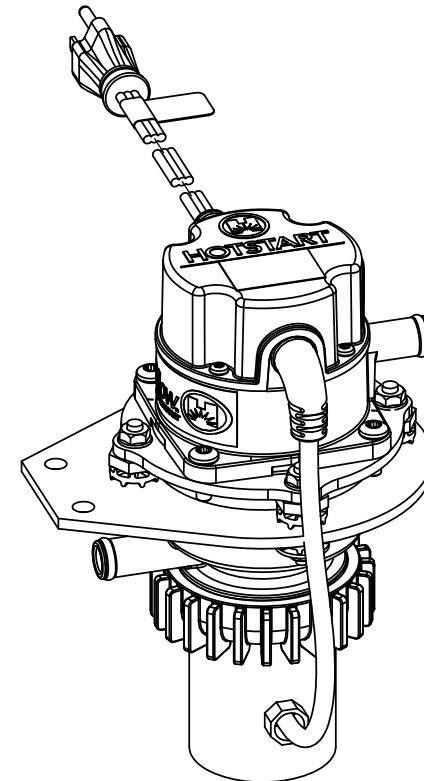
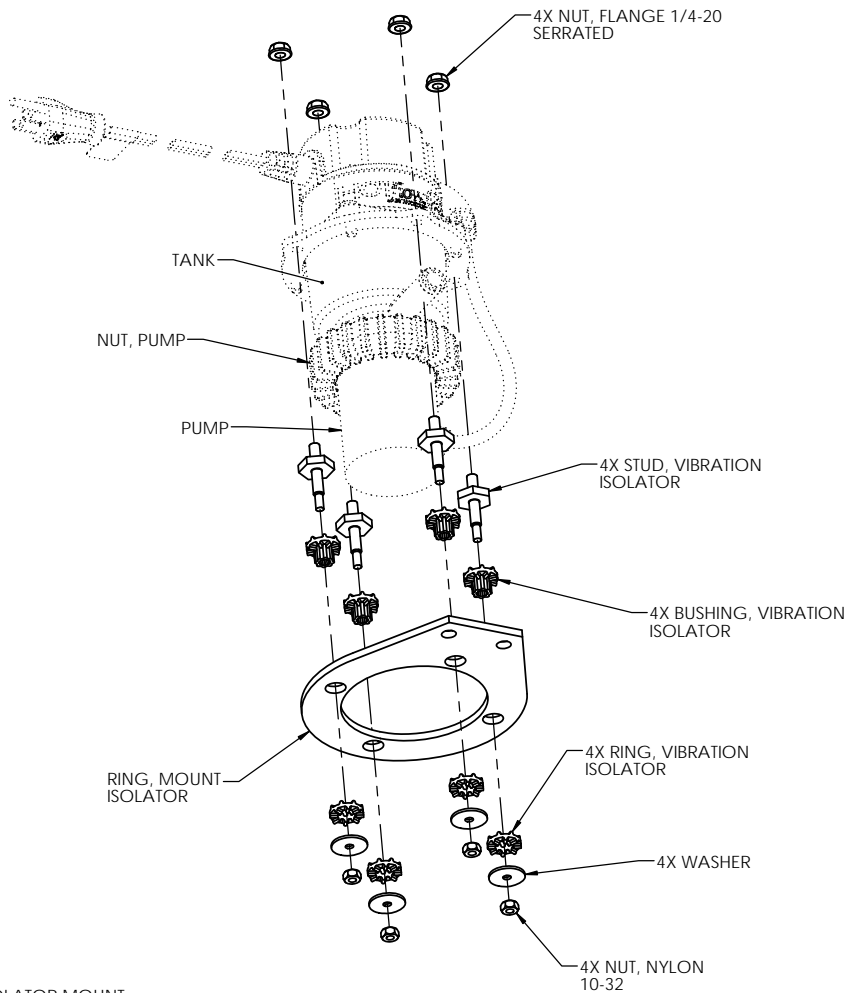


REVISIONS					
REV.	ECO	DATE	DESCRIPTION	AUTH.	DR.
1	7624	05-21-12	ADDED 216240-002	MM	ER







NOTES:

1. TO INSTALL ISOLATOR MOUNT:



- 1. LOOSEN PUMP NUT AND PULL THE PUMP AWAY FROM THE TANK.
- 2. PLACE THE ISOLATOR MOUNT AROUND THE TANK ABOVE THE OUTLET PORT.
- 3. RE-FASTEN THE PUMP TO THE TANK AND TORQUE THE NUT TO 100 IN-LB.
- 4. ASSEMBLE THE KIT AS SHOWN & ORIENT AS NEEDED FOR OPTIMUM PORT LOCATION.

216240-002	INSTRUCTIONS INSTALL CTM MOUNTING ISOLATION	1
CTM-IMK	KIT, CTM MOUNTING ISOLATION	
P/N	DESCRIPTION	

		<h1>HOTSTART, INC. SPOKANE, WA.</h1>	
<h2>HOTSTART.</h2>		<h3>PROPRIETARY INFORMATION</h3> <p>This drawing and the information shown on it are property of Hotstart, Inc. and are for the sole purpose of doing business with us. Any copying or transmittal to others of this information is strictly prohibited without prior written consent Hotstart.</p>	
TITLE KIT, CTM MOUNTING ISOLATION			
APPROVALS		DWG. NO.	
DRAWN BY	DATE	CTM-IMKS	
ER	04-27-12	UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES (mm)	
APPROVED BY		TOLERANCES	
JH	04-27-12	xx ± N/A ANGULAR xxx ± N/A ± N/A/°	
THIRD ANGLE PROJECTION		SIZE	CO7624
		B	
		SCALE	1:3
		SHEET	1 OF 2
			REV 01

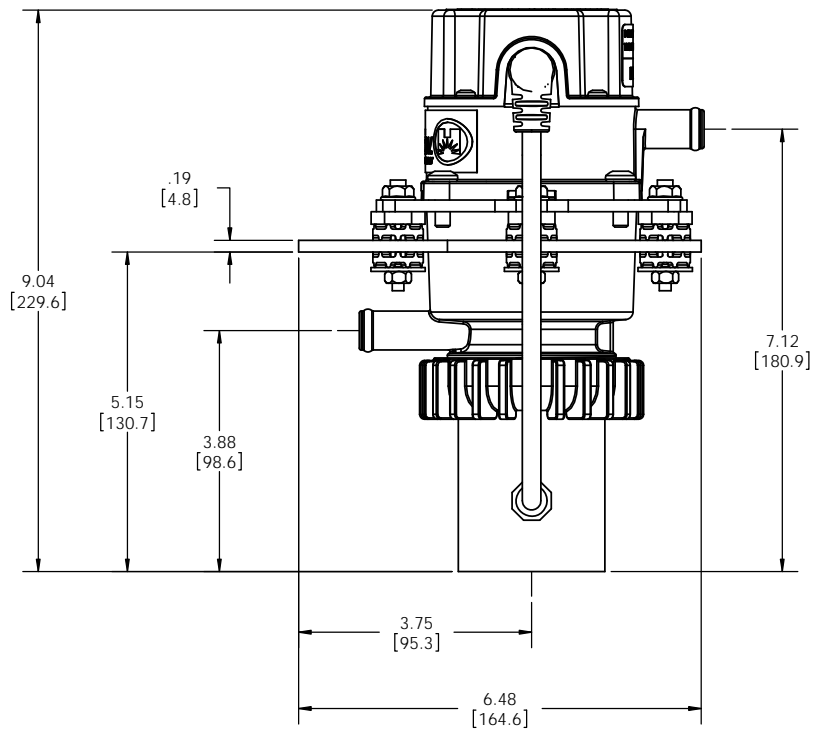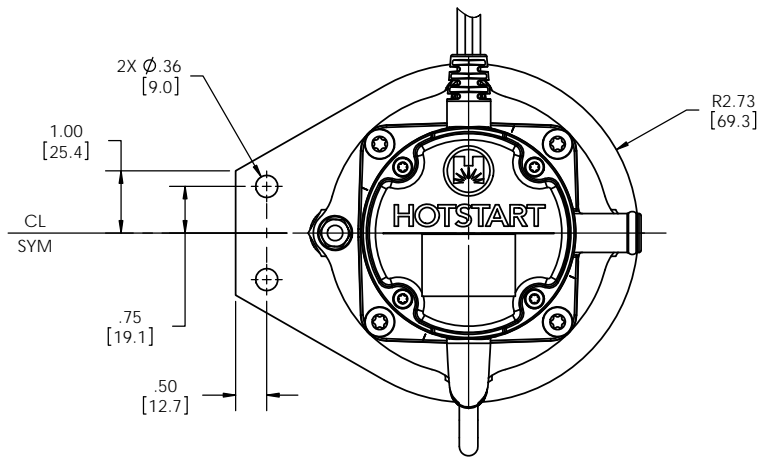

REVISIONS					
REV.	ECO	DATE	DESCRIPTION	AUTH.	DR.

 HOTSTART.		HOTSTART, INC. SPOKANE, WA. PROPRIETARY INFORMATION <small>This drawing and the information shown on it are property of Hotstart, Inc. and are for the sole purpose of doing business with us. Any copying or transmittal to others of this information is strictly prohibited without prior written consent Hotstart.</small>	
		CTM IMKS	
TITLE KIT, CTM MOUNTING ISOLATION		DWG. NO. CTM-IMKS	
APPROVALS DRAWN BY: ER APPROVED BY: JH	DATE 04-27-12 04-27-12	UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES (mm) TOLERANCES DECIMAL ANGULAR .XX ± N/A ° ± N/A ° .XXX ± N/A ° ± N/A ° DO NOT SCALE DRAWING	SIZE B ORIGIN CO7624
THIRD ANGLE PROJECTION		SCALE 1:2	SHEET 2 OF 2 REV 01