


A7-1442

ISSUE  
C

IF IN DOUBT-ASK

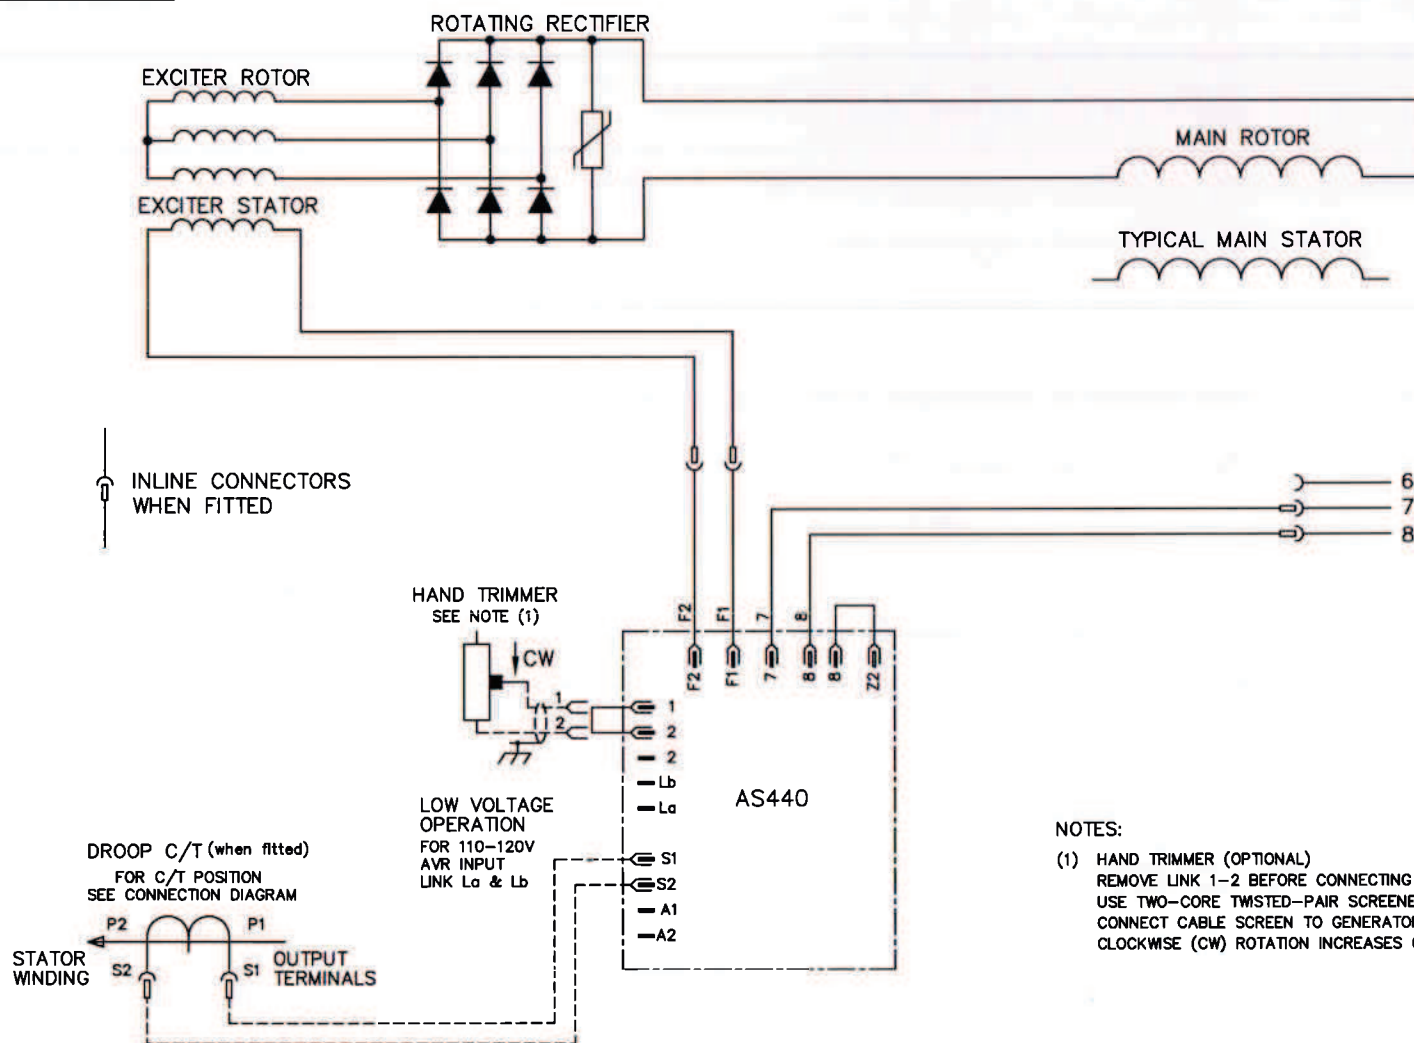

## NOTES:

- (1) HAND TRIMMER (OPTIONAL)  
 REMOVE LINK 1-2 BEFORE CONNECTING  
 USE TWO-CORE TWISTED-PAIR SCREENED CABLE (RATED 250Vac/1A)  
 CONNECT CABLE SCREEN TO GENERATOR FRAME/EARTH  
 CLOCKWISE (CW) ROTATION INCREASES GENERATOR VOLTAGE

## BASE DIAGRAM

| CERTIFIED PRINT  |     |          | FRAME             |  | OTHER FEATURES |  |
|------------------|-----|----------|-------------------|--|----------------|--|
| (ONLY IF SIGNED) |     |          | CONTROL           |  | SERIES AS440   |  |
| BY               |     |          | POLES             |  |                |  |
| DATE             |     |          | No. OF ENDS       |  | ---            |  |
| DRAWN            | DFC | 01.08.06 | SENSING           |  | 2 PHASE        |  |
| CHK'D            | JKB | 05.11.10 | CUMMINS GENERATOR |  |                |  |
| APP'D            | PN  | 08.11.10 | TECHNOLOGIES LTD. |  |                |  |

|           |     |     |          |                                    |
|-----------|-----|-----|----------|------------------------------------|
| 5-0797-01 | C   | JKB | 05.11.10 | CONNECTORS ADDED FOR PLUG AND PLAY |
| 4-8664-01 | B   | USD | 14.09.06 | CHANGE OF COMPANY NAME             |
| 4-8606-01 | A   | DFC | 08.08.06 | ORIGINAL ISSUE                     |
| MOD       | ISS | DRN | DATE     | ALTERATION                         |

A7-1442

ISSUE  
C

SHEET 1 OF 1 SHEETS